


# CGSLPGiS Datasheet

## Liquid Petroleum Gas




### **Product Overview**

The iS range of CGS detectors work in combination with the CGS Merlin range of Gas Detection panels and Utility Controllers or can be used as a standalone detector. The CGSLPGiS features a semiconductor sensor for industrial and commercial indoor applications. Compact, modern, digital design makes the units aesthetically pleasing and easy to install.

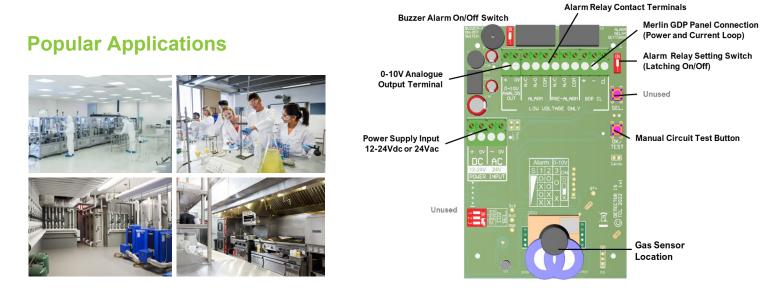

## **Technical Specification**

General								
Model:		Detec	Detector i-S					
Target Gas		LPG	LPG					
Size: (H x W x D)		5.95 x	5.95 x 4.37 x 1.97" (151 x 111 x 50mm)					
Housing Material:		ABS F	ABS PA765. Flame Retardant UL 94V-1					
Mounting:		Safe Z	Safe Zone - Indoor use - Wall Mounted					
Weight:	212g	212g						
User Interface								
Display:	1.8" T	1.8" TFT						
Screen Brightne	Non-A	Non-Adjustable						
Visual Indicators	Gas L	Gas Level (Green: Normal; Yellow: Pre-Alarm; Red: Alarm) 0-10V Output: Relay Output						
Audible Alarm:	>65dE	>65dB @ 3.28ft (1m). Quiet conditions.						
Language:	Englis	English						
Power Supply								
Max. Power Con	1.8W	1.8W						
Power Rating:	12-24	12-24V AC or DC						
Relays								
Volt Free BMS re	1A sw	1A switching current (resistive load) @ 24V AC/DC						
Environmental								
Ingress Protection	Not Fo	Not Formally Evaluated						
Operating:	-10 ~	-10 ~ 50°C / 20 ~ 90% RH (non-condensing)						
Storage:	0 ~ 50	0 ~ 50°C / 30 - 80% RH (no condensation)						
Altitude Rating:	2000n	2000m						
Wiring		i i i i i i i i i i i i i i i i i i i						
Typical	Min. 2	Min. 2.5mm2 / 75°C min / Tinned copper.						
Approvals								
Electrical Safety	BS EN	BS EN 61010-1:2010 +A1:2019.						
Electromagnetic Compatibility		BS EN	BS EN 50270.					
Sensor Specific	ation							
Factory Calibration Conditions 25° ±		25° ± 5°C - 77	± 5°C - 77° ± 41°F (40-70% RH)					
Sensor Type Semi		Semiconducto	iconductor					
Gas Sensor	Measuring Range (%LEL)	Calibration Gas	Response (T90)	Recovery (T10)	<b>Alarm: 1</b> (Pre alarm warning)	Alarm: 2	*EOL (Years)	
Liquid Petroleum Gas (LPG)	0-10%	10% LEL	<30s	<30s	▲8%LEL	▲10%LEL	10	

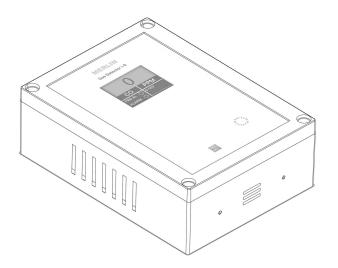

#### Area of coverage

Consider the coverage required and function of the area. Emphasis should be placed on airflow patterns and correct placement, not perceived detecting ranges.

The CGSLPGiS monitor should be installed approximately 1ft from the ground level.

#### Find out more Canadian Gas Safety Inc

www.canadiangassafety.com

Head office: 150 King Street West Suite 200, Toronto, ON M5H 1J9 Tel: (647) 577-1500 Email: info@canadiangassafety.com

