


Emergency Shutoff Button Installation Manual

Replaces: CGSEGOTW, CGSEPOTW, AND CGSEBOTW

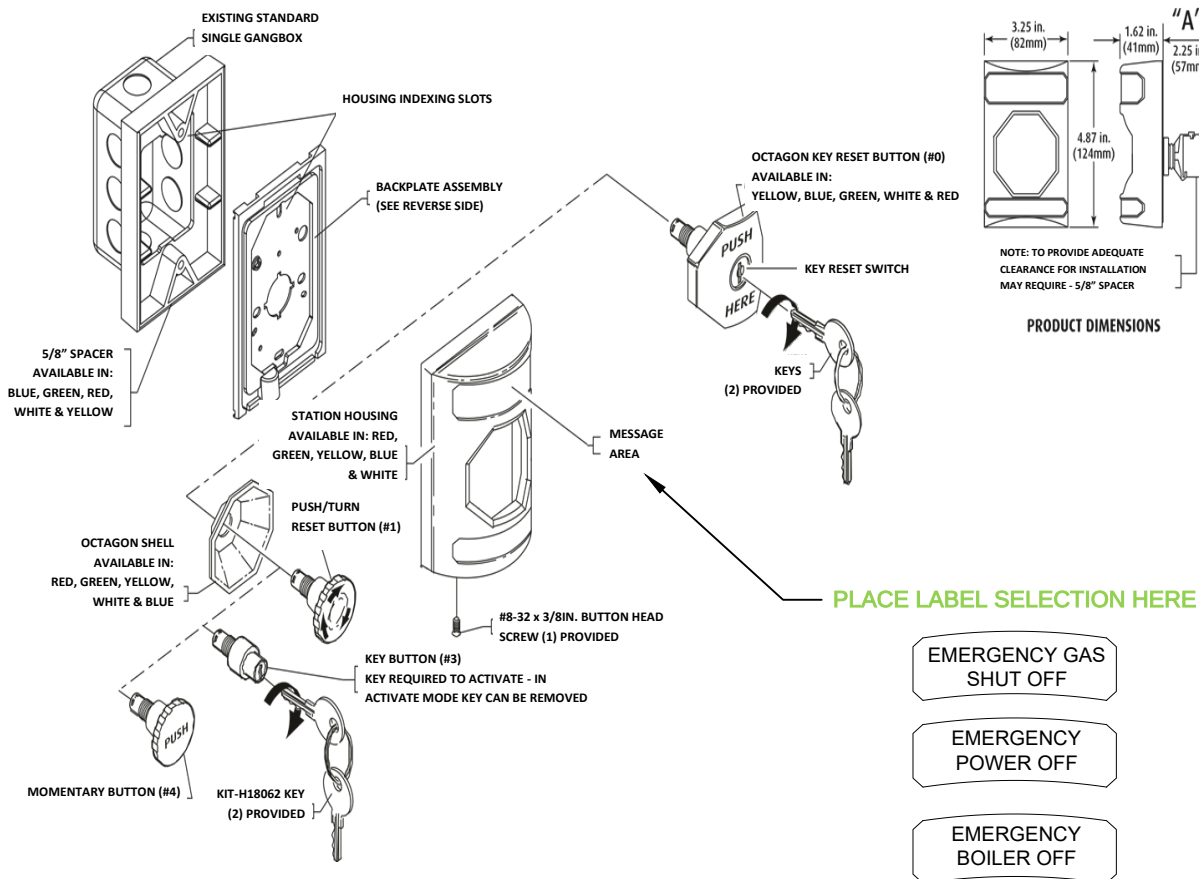

UL294 Performance levels:

Line Security: I Endurance: IV
Attack: I Standby Power: I

Warranty:


Three year warranty as standard. For more information contact Canadian Gas Safety -
www.canadiangassafety.com / (647) 577-1500



www.canadiangassafety.com

Emergency Shutoff Button Installation Manual

Replaces: CGSEGOTW, CGSEPOTW, AND CGSEBOTW

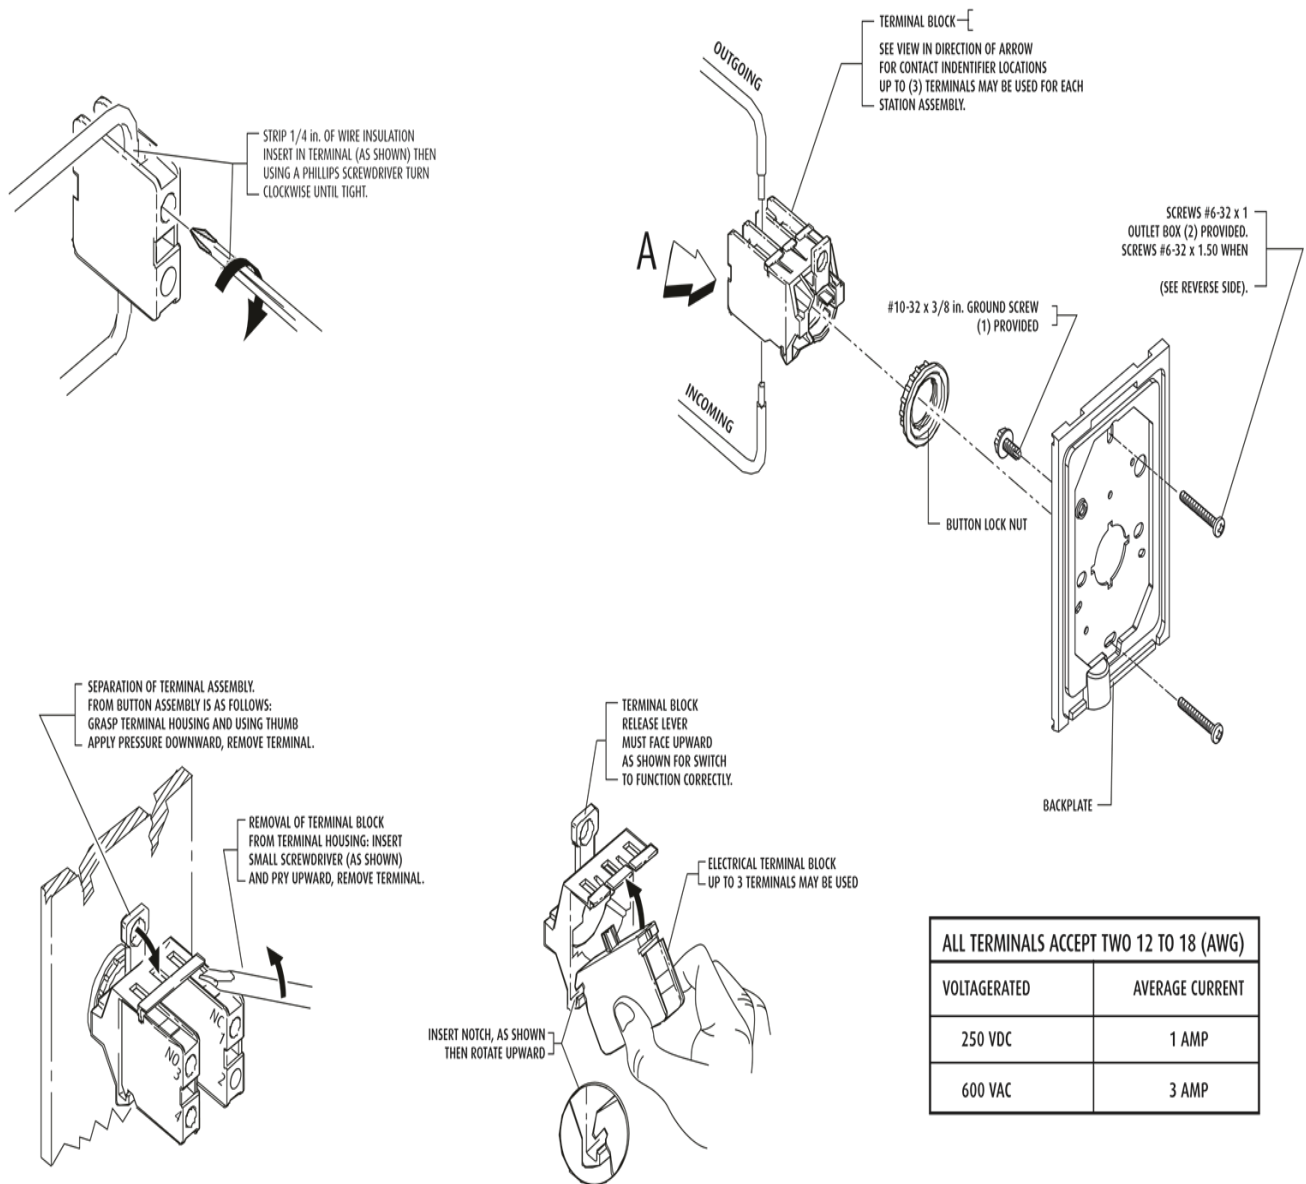

ALL TERMINALS ACCEPT TWO 12 TO 18 (AWG)	
VOLTAGE/RATED	AVERAGE CURRENT
250 VDC	1 AMP
600 VAC	3 AMP

